


WATER FLOW TEST SUMMARY SHEET

Hydrant No.	Outlet I.D. inches	Pitot Press. psi	Flow gpm	Residual psi	Date:	Time:	Cont. No.
1							
2							
3							
Total Flow					Static Press: _____ psi	Flow @ 20 psi _____ gpm	

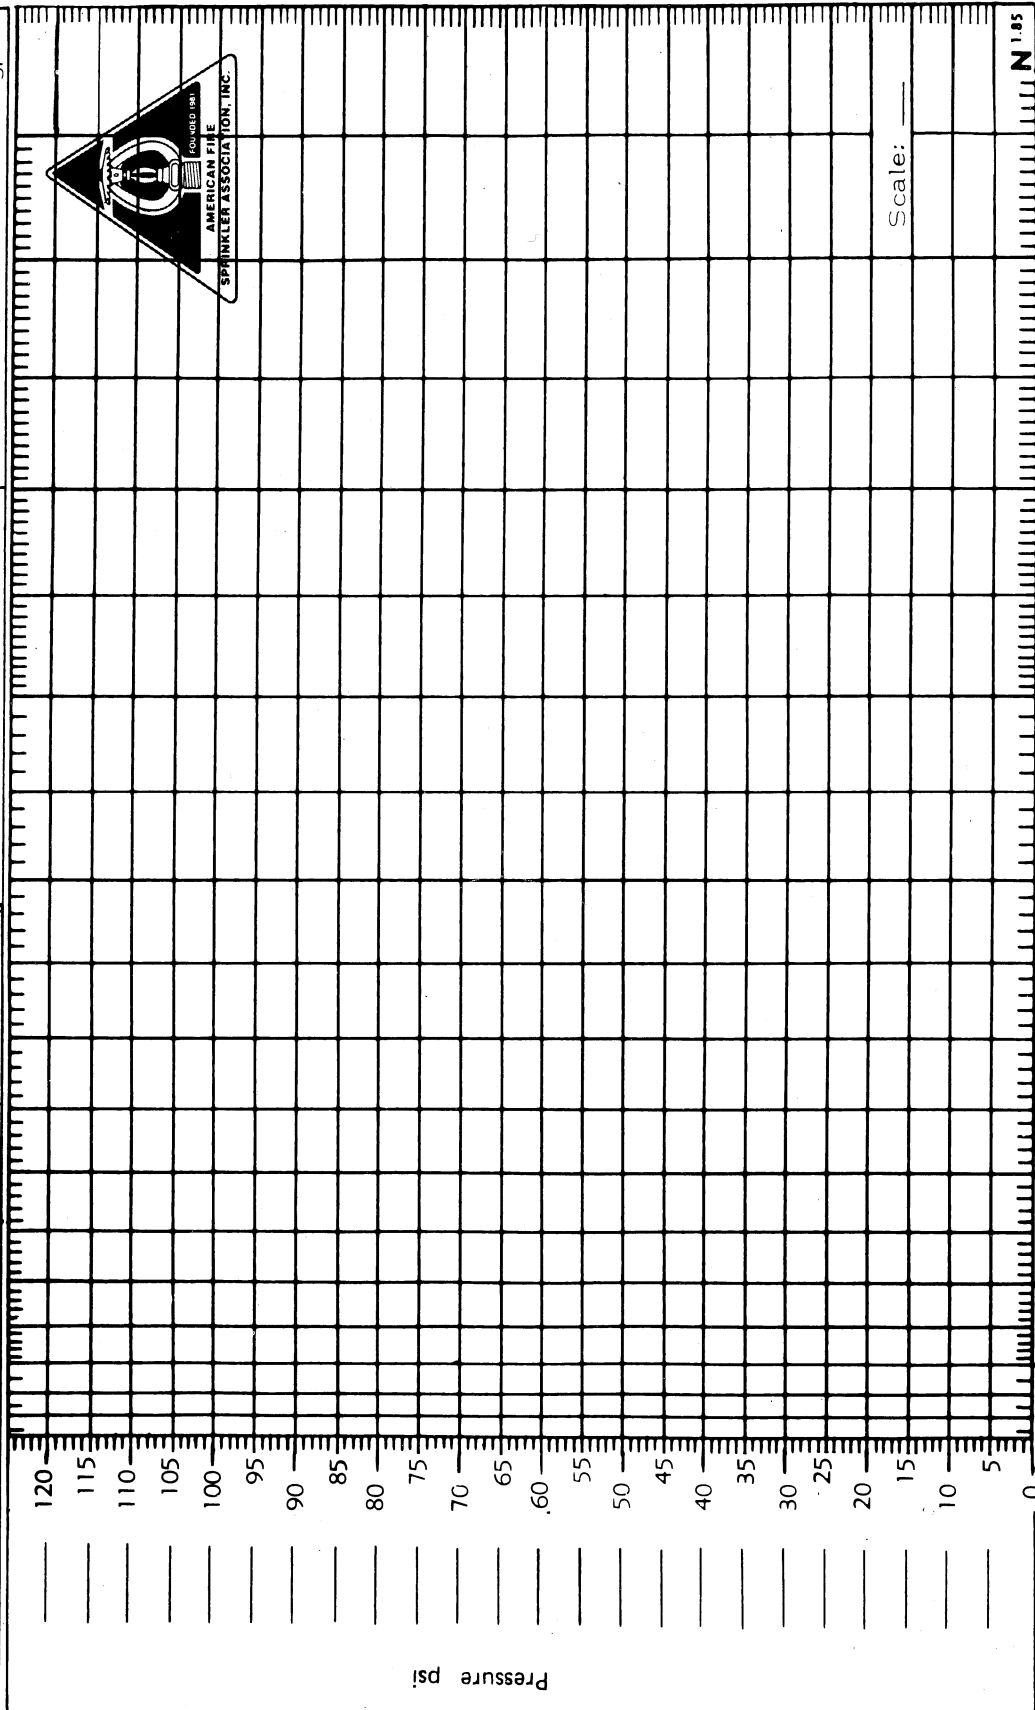

Scale A 100 200 300 400 500 600 700 800 900 1000 1100 1200 1300 1400 1500 1600 1700 1800 1900 2000 2100 2200 2300 2400 2500 2600 2700 2800 2900 3000 3100 3200 3300 3400 3500 3600 3700 3800 3900 4000

Scale B 100 200 300 400 500 600 700 800 900 1000 1100 1200 1300 1400 1500 1600 1700 1800 1900 2000 2100 2200 2300 2400 2500 2600 2700 2800 2900 3000 3100 3200 3300 3400 3500 3600 3700 3800 3900 4000

Scale C 100 200 300 400 500 600 700 800 900 1000 1100 1200 1300 1400 1500 1600 1700 1800 1900 2000 2100 2200 2300 2400 2500 2600 2700 2800 2900 3000 3100 3200 3300 3400 3500 3600 3700 3800 3900 4000

Water Flow gpm

AMERICAN FIRE SPRINKLER ASSOCIATION, INC.
11325 Pegasus, Suite S-220
Dallas, Texas 75228